Tes

T&S BRASS AND BRONZE WORKS, INC.

2 Saddleback Cove / P.O. Box 1088 Travelers Rest, SC 29690 Model No.

EC-3104-VF05-HG

Item No.

NSF 61 - Section 9 NSF 372 (Low Lead Content)

1:6

Sheet: 1 of 2


ANSI A117.1 (ADA)

Scale:

UL 1951

04/05/22

Travelers Rest, SC: 800-476-4103 • Simi Valley, CA: 800-423-0150 • Fax: 864-834-3518 • www.tsbrass.com

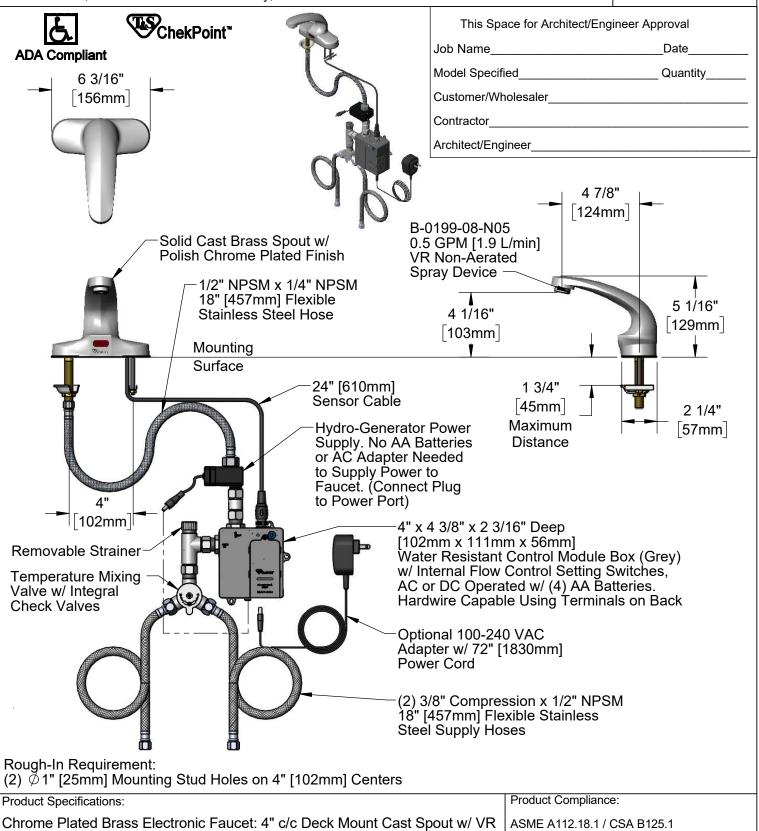

0.5 GPM Non-Aerated Spray Device, AC/DC Control Module w/ Internal Flow Control Setting Switches, Temperature Control Mixing Valve w/ Check Valves,

Approved:

Date:

JRM

Hydro-Generator, 18" Flexible Stainless Steel Supply Hoses

Checked:

Drawn:

DMH




T&S BRASS AND BRONZE WORKS, INC.

2 Saddleback Cove / P.O. Box 1088 Travelers Rest, SC 29690 Model No.


EC-3104-VF05-HG


Item No.

Travelers Rest, SC: 800-476-4103 • Simi Valley, CA: 800-423-0150 • Fax: 864-834-3518 • www.tsbrass.com

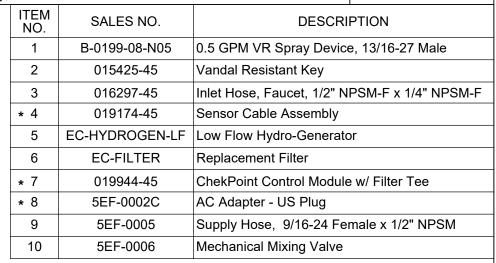

* For Versions Prior to 2021, Consult with T&S Customer Service





-Flow Control Switches are Located Behind Battery Compartment Cover.

- * Switches are Set to DEFAULT Position:
 - Auto Time Out = 15 Seconds
 - Shut Off Delay = 1 Second
 - Auto Flush = ÓFF
 - Metering Mode = OFF
- * Available Water Flow Control Selections:
- Auto Time Out: 15 sec, 30 sec, 45 sec, 60 sec, 3 min, 20 min
- Shut Off Delay: 1 sec, 10 sec, 15 sec, 30 sec
- Auto Flush (30 Seconds After Every 12 Inactive Hours): ON or OFF
- Metering Mode: ON or OFF

(10)

(9

Chrome Plated Brass Electronic Faucet: 4" c/c Deck Mount Cast Spout w/ VR 0.5 GPM Non-Aerated Spray Device, AC/DC Control Module w/ Internal Flow Control Setting Switches, Temperature Control Mixing Valve w/ Check Valves, Hydro-Generator, 18" Flexible Stainless Steel Supply Hoses

Product Compliance:

ASME A112.18.1 / CSA B125.1 NSF 61 - Section 9 NSF 372 (Low Lead Content) ANSI A117.1 (ADA) UL 1951

	Drawn:	DMH	Checked:	JRM	Approved:	JHB	Date:	04/05/22	Scale:	NTS	Sheet: 2 of 2
--	--------	-----	----------	-----	-----------	-----	-------	----------	--------	-----	---------------